

Up-Way Systems

Travessa José Oliveira Mendes,
n.º 87 e n.º 103 Calendário
4760-912 Vila Nova de Famalicão
Portugal

Tel: 00 351 252 085 574

e-mail: geral@effisus.com

website: www.effisus.com



Agrément Certificate

21/5951

Product Sheet 1 Issue 2

EFFISUS ECOFACADE ENVELOPE SYSTEM

EFFISUS VAPOUR FR MEMBRANE SYSTEM

This Agrément Certificate Product Sheet⁽¹⁾ relates to the Effisus Vapour FR Membrane System, an aluminium-foiled glass fibre membrane for use as an air and vapour control layer (AVCL) in timber-frame, steel-frame and masonry wall constructions, and suspended concrete and suspended timber ground floors of domestic and non-domestic buildings.

(1) Hereinafter referred to as 'Certificate'.

The assessment includes

Product factors:


- compliance with Building Regulations
- compliance with additional regulatory or non-regulatory information where applicable
- evaluation against technical specifications
- assessment criteria and technical investigations
- uses and design considerations

Process factors:

- compliance with Scheme requirements
- installation, delivery, handling and storage
- production and quality controls
- maintenance and repair

Ongoing contractual Scheme elements†:

- regular assessment of production
- formal 3-yearly review

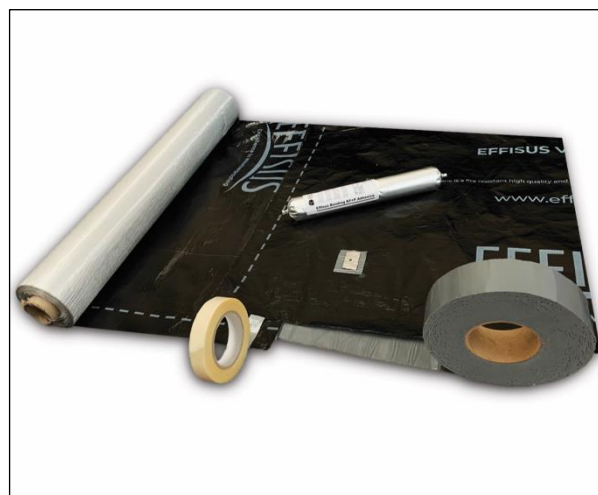

KEY FACTORS ASSESSED

- Section 1. Mechanical resistance and stability
- Section 2. Safety in case of fire
- Section 3. Hygiene, health and the environment
- Section 4. Safety and accessibility in use
- Section 5. Protection against noise
- Section 6. Energy economy and heat retention
- Section 7. Sustainable use of natural resources
- Section 8. Durability

The BBA has awarded this Certificate to the company named above for the system described herein. This system has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Date of Second issue: 5 November 2024

Originally certified on 21 September 2021

Hardy Giesler
Chief Executive Officer

This BBA Agrément Certificate is issued under the BBA's Inspection Body accreditation to ISO/IEC 17020. Sections marked with † are not issued under accreditation.

The BBA is a UKAS accredited Inspection Body (No. 4345), Certification Body (No. 0113) and Testing Laboratory (No. 0357).

Readers MUST check that this is the latest issue of this Agrément Certificate by either referring to the BBA website or contacting the BBA directly.

The Certificate should be read in full as it may be misleading to read clauses in isolation.

Any photographs are for illustrative purposes only, do not constitute advice and should not be relied upon.

British Board of Agrément

1st Floor, Building 3, Hatters Lane
Croxley Park, Watford
Herts WD18 8YG

©2024

tel: 01923 665300
clientservices@bbacerts.co.uk
www.bbacerts.co.uk

SUMMARY OF ASSESSMENT AND COMPLIANCE

This section provides a summary of the assessment conclusions; readers should refer to the later sections of this Certificate for information about the assessments carried out.

Compliance with Regulations

Having assessed the key factors, the opinion of the BBA is that the Effisus Vapour FR Membrane System, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements of the following Building Regulations:



The Building Regulations 2010 (England and Wales) (as amended)

Requirement:	B3(4)	Internal fire spread (structure)
Comment:		The system can contribute to satisfying this Requirement. See section 2 of this Certificate.
Requirement:	B4(1)	External fire spread
Comment:		The system may be unrestricted by this Requirement. See section 2 of this Certificate.
Requirement:	C2(c)	Resistance to moisture
Comment:		The system can contribute to satisfying this Requirement. See section 3 of this Certificate.
Requirement:	L1(a)(i)	Conservation of fuel and power
Comment:		The system can contribute to satisfying this Requirement. See section 6 of this Certificate.
Regulation:	7(1)	Materials and workmanship
Comment:		The system is acceptable. See sections 8 and 9 of this Certificate.
Regulation:	25B	Nearly zero-energy requirements for new buildings
Regulation:	26	CO₂ emission rates for new buildings
Regulation:	26A	Fabric energy efficiency rates for new dwellings (applicable to England only)
Regulation:	26A	Primary energy rates for new buildings (applicable to Wales only)
Regulation:	26B	Fabric performance values for new dwellings (applicable to Wales only)
Regulation:	26C	Target primary energy rates for new buildings (applicable to England only)
Regulation:	26C	Energy efficiency rating (applicable to Wales only)
Comment:		The system can contribute to satisfying these Regulations. See section 3 of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)	Fitness and durability of materials and workmanship
Comment:		The system is acceptable. See sections 8 and 9 of this Certificate.
Regulation:	9	Building standards – construction
Standard:	2.4	Cavities
Comment:		The system can contribute to satisfying this Standard, with reference to clause 2.4.2 ⁽¹⁾⁽²⁾ . See section 2 of this Certificate.
Standard:	3.15	Condensation
Comment:		The system can contribute to satisfying this Standard, with reference to clauses 3.15.1 ⁽¹⁾⁽²⁾ and 3.15.5 ⁽¹⁾⁽²⁾ . See section 3 of this Certificate.

Standard:	6.1(b)(c)	Energy demand
Standard:	6.2	Building insulation envelope
Comment:	The system can contribute to satisfying these Standards, with reference to clauses 6.1.1 ⁽¹⁾ , 6.1.2 ⁽²⁾ , 6.2.4 ⁽¹⁾ and 6.2.5 ⁽²⁾ . See section 3 of this Certificate.	
Standard:	7.1(a) b)	Statement of sustainability
Comment:	The system can contribute to satisfying the relevant requirements of Regulation 9, Standards 1 to 6, and therefore will contribute to a construction meeting at least a bronze level of sustainability as defined in this Standard. In addition, the system can contribute to a construction meeting a higher level of sustainability as defined in this Standard, with reference to clauses 7.1.4 ⁽¹⁾ , 7.1.6 ⁽¹⁾ 7.1.7 ⁽¹⁾ , 7.1.9 ⁽²⁾ and 7.1.10 ⁽²⁾ . See section 3 of this Certificate.	
Regulation:	12	Building standards – conversion
Comment:	All comments given for the system under Regulation 9, Standards 1 to 6, also apply to this Regulation, with reference to clause 0.12.1 ⁽¹⁾⁽²⁾ and Schedule 6 ⁽¹⁾⁽²⁾	
	(1) Technical Handbook (Domestic).	
	(2) Technical Handbook (Non-Domestic).	



The Building Regulations (Northern Ireland) 2012 (as amended)

Regulation:	23(1)(a)(i)	Fitness of materials and workmanship
Comment:	(iii)(b)(i)	The system is acceptable. See sections 8 and 9 of this Certificate.
Regulation:	29	Condensation
Comment:	The system can contribute satisfying this Regulation. See section 3 of this Certificate.	
Regulation:	35(4)	Internal fire spread – structure
Comment:	The system can contribute to satisfying this Regulation. See section 2 of this Certificate.	
Regulation:	36(a)	External fire spread
Comment:	The system may be unrestricted by this Requirement. See section 2 of this Certificate.	
Regulation:	39(a)(i)	Conservation measures
Regulation:	40(2)	Target carbon dioxide emission rate
Regulation:	43(1)(2)	Renovation of thermal elements
Regulation:	43B	Nearly zero-energy requirements for new buildings
Comment:	The system can contribute to satisfying these Regulations. See section 3 of this Certificate.	

Additional Information

NHBC Standards 2024

In the opinion of the BBA, the Effisus Vapour FR Membrane System, if installed, used and maintained in accordance with this Certificate, can satisfy or contribute to satisfying the relevant requirements in relation to *NHBC Standards*, Chapters 6.1 *External masonry walls*, 6.2 *External timber framed walls*, 6.9 *Curtain walling and cladding*, 6.10 *Light steel framed walls and floors* and 9.2 *Wall and ceiling finishes*.

Fulfilment of Requirements

The BBA has judged the Effisus Vapour FR Membrane System to be satisfactory for use as described in this Certificate. The system has been assessed as use as an AVCL in walls and floors.

ASSESSMENT

Product description and intended use

The Certificate holder provided the following description for the system under assessment. The Effisus Vapour FR Membrane is a multi-layer AVCL comprising a black water-based lacquer, an aluminium layer and an 84 gsm woven glass fibre.

The system has the nominal characteristics given in Table 1.

Table 1 Nominal characteristics

Characteristic (unit)	Effisus Vapour FR Membrane
Thickness (mm)	0.14
Mass per unit area (g·m ⁻²)	165
Roll length (m)	50
Roll width (m)	1.2
Colour	White underside, black top side and white logo

Ancillary Items

The following ancillary items are essential to use with the system and have been assessed with the system:

- Effisus 2Bond DS Tape – a double-sided tape for bonding/sealing between the same material or two different materials
- Effisus 2Adjoin DF Tape – a double-sided airtight and moisture-resistant sealing tape for weathertight/airtight joints
- Effisus Bonding KF+P Adhesive – a solvent-free adhesive/sealant paste for bonding the Effisus membrane to concrete, masonry, wood and steel.

The Certificate holder recommends the following ancillary items for use with the system but these materials have not been assessed by the BBA and are outside the scope of this Certificate:

- Effisus Coat NP Primer – a primer for porous surfaces
- Effisus Coat SP Primer – a primer for porous surface
- Effisus Setup PR Cleaner – a surface cleaner, used prior to the application of the adhesives and primer.

Product assessment – key factors

The system was assessed for the following key factors, and the outcome of the assessment is shown below. Conclusions relating to the Building Regulations apply to the whole of the UK unless otherwise stated.

1 Mechanical resistance and stability

Not applicable.

2 Safety in case of fire

Data were assessed for the following characteristics.

2.1 Reaction to fire

2.1.1 When tested in isolation and classified to EN 13501-1 : 2018, the Effisus Vapour FR Membrane achieved a reaction to fire classification of Class A1⁽¹⁾.

(1) Test and classification reports 20/23809-2432-1 and 20/23809-2432-2 issued by LGAI Technological Center, SA, and available from the Certificate holder on request.

2.1.2 When tested and classified to UNE EN 13501-1 : 2019, the build-up in Table 2 of this Certificate achieved a reaction to fire classification of Class A2-s1,d0⁽¹⁾.

(1) Test and classification reports 20/23809-2459-1 and 20/23809-2459-2 issued by LGAI Technological Center, SA, and available from the Certificate holder on request.

Table 2 Reaction to fire

Substrate	Calcium silicate according to EN 13238 : 2011 ⁽¹⁾
Air gap	None
Membrane	Effisus Vapour FR
Joints	Horizontal and vertical
Sealing tape	Effisus 2Adjoin DF
Joint tape	Effisus 2Bond DS
Adhesive	Effisus Adhesive KF+P

(1) Material outside the scope of the Certificate.

2.1.2 On the basis of data assessed, the construction given in Table 2 will be unrestricted in terms of height and proximity to a relevant boundary by the documents supporting the national Building Regulations.

2.1.3 This performance may not be achieved by other combinations of materials and the classification and permissible areas of use of these must be established in accordance with the requirements of the documents supporting the national Building Regulations.

2.1.4 Designers must refer to the relevant national Building Regulations and guidance for alternative approaches and detailed conditions of use, particularly in respect of requirements for cavity closers and barriers, fire stopping of service penetrations and combustibility limitations for other materials and components used in the overall wall construction.

3 Hygiene, health and the environment

Data were assessed for the following characteristics.

3.1 Resistance to water and water vapour

3.1.1 Results of resistance to water and water vapour tests are given in Table 3.

Table 3 Resistance to water and water vapour

System assessed	Assessment method	Requirement	Result
Effisus Vapour FR	Water vapour resistance to STN EN 1931 : 2001	Declared value $\geq 7500 \text{ MN}\cdot\text{s}\cdot\text{g}^{-1}$	Pass
Effisus Vapour FR	Watertightness to STN EN 1928 : 2000 at 2 kPa for 24 hours	No leakage	Pass

3.1.2 On the basis of data assessed, the system provides an effective control to the passage of liquid water and water vapour and will contribute to limiting the risk of interstitial condensation.

3.2 Airtightness

3.2.1 The results of airtightness tests are given in Table 3.

Table 3 Air permeability tests

System assessed	Assessment method	Requirement	Result
Effisus Vapour FR sealed with Effisus 2Adjoin DF tape	BS EN 1026 : 2016	No leakage at 600 Pa	Pass
Effisus Vapour FR and Effisus 2Adjoin DF Tape	Shear strength of joints to BS EN 12317-2 : 2010	Value achieved	$534 \text{ N}\cdot(50 \text{ mm})^{-1}$

3.2.2 When lapped, fixed and taped correctly, the system acts as an air barrier and can contribute to elements and junctions minimising heat loss by unplanned air infiltration and exfiltration. Guidance in this respect can be found in the documents supporting the national Building Regulations.

3.3 Resistance to mechanical damage

3.3.1 Results of resistance to mechanical damage tests are given in Table 4.

<i>Table 4 Mechanical damage</i>			
System assessed	Assessment method	Requirement	Result
Effisus Vapour FR	Tensile strength to	Declared value	
	BS EN 12311-2 : 2013		
	Longitudinal direction	$\geq 700 \text{ N} \cdot (50 \text{ mm})^{-1}$	Pass
	Transverse direction	$\geq 400 \text{ N} \cdot (50 \text{ mm})^{-1}$	Pass
Effisus Vapour FR	Elongation at maximum load to	Declared value	
	BS EN 12311-2 : 2013		
	Longitudinal direction	3%	Pass
	Transverse direction	3%	Pass
Effisus Vapour FR	Nail tear to	Declared value	
	BS EN 12310-1 : 2000		
	Longitudinal direction	$\geq 170 \text{ N}$	Pass
	Transverse direction	$\geq 130 \text{ N}$	Pass

3.3.2 On the basis of data assessed, the system has adequate strength to resist the loads associated with installation of the wall or floor.

4 Safety and accessibility in use

Not applicable.

5 Protection against noise

Not applicable.

6 Energy economy and heat retention

Not applicable

7 Sustainable use of natural resources

Not applicable.

8 Durability

8.1 The potential mechanisms for degradation and the known performance characteristics of the materials in the system were assessed.

8.2 Specific test data were assessed as given in Table 5.

Table 5 Results of durability tests

System assessed	Assessment method	Requirement	Result
Effisus Vapour FR	Tensile strength to BS EN 12311-2 : 2013 after heat ageing at 70°C for 84 days	No significant deterioration	
	Longitudinal direction		Pass
	Transverse direction		Pass
Effisus Vapour FR and Effisus 2Adjoin DF Tape	Shear strength of joints to BS EN 12317-2 : 2010 after heat ageing at 80°C for 28 days	No significant deterioration	Pass
Effisus Vapour FR	Water vapour resistance to STN EN 1931 : 2001 2 kPa for 24 hours after heat ageing for 84 days at 70°C	No leakage for 24 hours	Pass

8.4 Service life

Under normal service conditions, the system will have a life of at least equivalent to that of the building in which it is incorporated, provided it is designed, installed and maintained in accordance with this Certificate and the Certificate holder's instructions.

PROCESS ASSESSMENT

Information provided by the Certificate holder was assessed for the following factors:

9 Design, installation, workmanship and maintenance

9.1 Design

9.1.1 The design process was assessed by the BBA and the following requirements apply in order to satisfy the performance specified in this Certificate.

9.1.2 Where constructions need to comply with *NHBC Standards 2024*, specifiers must observe the requirements given in that document.

9.1.3 It is essential that proper care and attention is given to maintaining the system's integrity and continuity.

9.1.4 New elements must incorporate the system on the warm side of the insulation, and the overall construction must be designed and constructed in accordance with the relevant good practice, statutory Regulations and Standards.

9.1.5 Existing elements must be in a good state of repair without evidence of rain penetration, damp or frost damage.

9.1.6 Walls in new buildings must be designed and constructed in accordance with the relevant recommendations of BS EN 1996-1-1 : 2022 and BS EN 1996-2 : 2006, and their UK National Annexes.

9.1.7 Suspended concrete and suspended timber ground floors incorporating the system must include suitable ventilation.

9.1.8 The risk of condensation occurring will depend upon the properties and vapour resistance of other materials used in the construction, the internal and external conditions, and the effectiveness of the system's installation.

9.1.9 in the overall installation, consideration must be given to minimising penetrations by services. Joints at ceilings/ walls, wall/floor junctions and openings must be sealed to offer significant resistance to water vapour transmission. Sealing must also be carried out in accordance with the Certificate holder's instructions.

9.1.10 Constructions must be in accordance with the relevant recommendations of BS 5250 : 2021, using a minimum equivalent air layer thickness (s_d) of not less than 1500 m (equivalent to a water vapour resistance of 7500 MN·s·g⁻¹) for the system.

9.2 Installation

9.2.1 Installation instructions provided by the Certificate holder were assessed and judged to be appropriate and adequate.

9.2.2 Installation must be carried out in accordance with this Certificate and the Certificate holder's instructions. A summary of instructions and guidance is provided in Annex A of this Certificate.

9.2.3 The system must be located on the internal face (warm side) of the back wall.

9.2.4 The weatherproofing design of the installation must be carried out in detail, and on a case by case basis.

9.2.5 Effisus 2A Adjoin DF Tape must be spaced at a maximum of 600 mm, vertically and horizontally.

9.2.6 Effisus 2Bond DS Tape or Effisus Bonding KF+P Adhesive must be applied continuously on the connections of the membrane edges/end laps to concrete, aluminium or any other substrate, always allowing for interface movement.

9.2.7 Horizontal membrane joints must overlap by 100mm minimum and must be sealed with 2 bands of Effisus 2Adjoin DF Tape.

9.2.8 -Vertical membrane joints must overlap by 150mm minimum and must be sealed with 2 bands of Effisus 2Adjoin DF Tape.

9.2.9 For detailing, all nail/screw perforations below 25 mm in diameter must be sealed with a patch (50 x 50 mm) of Effisus 2Bond DS Tape. Facade perforations with irregular shapes and above 25 mm in diameter must be studied in detail case by case. All tapes, adhesives and sealants must not be applied in rain or if the temperature is below 5°C. Primer is required for temperatures below 5°C. The Certificate holder can advise on suitable materials for this purpose, but such advice and materials are outside the scope of this Certificate .

9.3 Workmanship

Practicability of installation was assessed by the BBA, on the basis of the Certificate holder's information. To achieve the performance described in this Certificate, installation of the system must be carried out by a competent contractor, experienced with this type of system.

9.4 Maintenance and repair

9.4.1 As the system is confined within the wall or structure and has suitable durability, maintenance is not required.

9.4.2 Any damaged areas must be repaired or replaced before completion. Damage to the membrane can be repaired with patches of Effisus Vapour FR Membrane and Effisus 2Bond DS Tape or Effisus Bonding KF+P Adhesive. Extensive areas of damage must be made good by overlaying the damaged area with a new sheet, sealed in place with Effisus 2Bond DS Tape or Effisus Bonding KF+P Adhesive.

10 **Manufacture**

10.1 The production processes for the system have been assessed, and provide assurance that the quality controls are satisfactory according to the following factors:

10.1.1 The manufacturer has provided documented information on the materials, processes, testing and control factors.

10.1.2 The quality control operated over batches of incoming materials has been assessed and deemed appropriate and adequate.

10.1.3 The quality control procedures and product testing to be undertaken have been assessed and deemed appropriate and adequate.

10.1.4 The process for management of non-conformities has been assessed and deemed appropriate and adequate.

10.1.5 An audit of each production location was undertaken, and it was confirmed that the production process was in accordance with the documented process, and that equipment has been properly tested and calibrated.

† 10.2 The BBA has undertaken to review the above measures on a regular basis through a surveillance process, to verify that the specifications and quality control operated by the manufacturer are being maintained.

11 Delivery and site handling

11.1 The Certificate holder stated that the system is delivered to site in rolls, with paper and polythene wrappings bearing the Certificate holder's name, the grade identification, the technical specifications, and the BBA logo incorporating the number of this Certificate.

11.2 Delivery and site handling must be performed in accordance with the Certificate holder's instructions and this Certificate, including:

11.2.1 The rolls must be stored flat on their sides, on a smooth, clean, dry surface, under cover and protected from sunlight, extreme weather conditions or any type of puncture, and within 5°C and 20°C.

†ANNEX A – SUPPLEMENTARY INFORMATION

Supporting information in this Annex is relevant to the system but has not formed part of the material assessed for the Certificate.

Construction (Design and Management) Regulations 2015

Construction (Design and Management) Regulations (Northern Ireland) 2016

Information in this Certificate may assist the client, designer (including Principal Designer) and contractor (including Principal Contractor) to address their obligations under these Regulations.

CE marking

The Certificate holder has taken the responsibility of CE marking the system in accordance with harmonised European Standard EN 13984 : 2013.

Management Systems Certification for production

The management system of the manufacturer has been assessed and registered as meeting the requirements of EN ISO 9001 : 2015 and ISO 14001 : 2015 by KIWA (Certificates 1386 -13 and 4760-09 respectively).

Bibliography

BS 5250 : 2021 *Code of practice for control of condensation in buildings*

BS EN 1026 : 2016 *Windows and doors — Air permeability — Test method*

BS EN 1996-1-1 : 2022 *Eurocode 6 — Design of masonry structures— General rules for reinforced and unreinforced masonry structures*

NA to BS EN 1996-1-1 : 2005 + A1 : 2012 *UK National Annex to Eurocode 6 — Design of masonry structures — General rules for reinforced and unreinforced masonry structures*

BS EN 1996-2 : 2006 *Eurocode 6, Design of masonry structures Design considerations, selection of materials and execution of masonry*

NA to BS EN 1996-2 : 2006 *UK National Annex to Eurocode 6 — Design of masonry structures — Design considerations, selection of materials and execution of masonry*

BS EN 12310-1 : 2000 *Flexible sheets for waterproofing — Determination of resistance to tearing (nail shank) — Bitumen sheets for waterproofing*

BS EN 12311-2 : 2013 *Flexible sheets for waterproofing — Determination of tensile properties — Plastic and rubber sheets for waterproofing*

EN 12317-2 : 2010 *Flexible sheets for waterproofing — Determination of shear resistance of joints — Plastic and rubber sheets for waterproofing*

EN 13238 : 2011 *Reaction to fire tests for building products — Conditioning procedures and general rules for selection of substrates*

EN 13501-1 : 2018 *Fire classification of construction products and building elements — Classification using data from reaction to fire tests*

EN 13984 : 2013 *Flexible sheets for waterproofing — Plastic and rubber vapour control layers — Definitions and characteristics*

EN ISO 9001 : 2015 *Quality management systems — Requirements*

ISO 14001 : 2015 *Environmental management systems — Requirements with guidance for use*

STN EN 1928 : 2000 *Flexible sheets for waterproofing — Bitumen, plastic and rubber sheets for roof waterproofing — Determination of watertightness*

STN EN 1931 : 2001 *Flexible sheets for waterproofing — Bitumen, plastic and rubber sheets for roof waterproofing — Determination of water vapour transmission properties*

UNE EN 13501-1 : 2019 *Fire classification of construction products and building elements — Classification using test data from reaction to fire tests*

Conditions

1 This Certificate:

- relates only to the product that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page – no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- has to be read, considered and used as a whole document – it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- and any matter arising out of or in connection with it or its subject matter (including non-contractual disputes or claims) is governed by and construed in accordance with the law of England and Wales.
- the courts of England and Wales shall have exclusive jurisdiction to settle any matter arising out of or in connection with this Certificate or its subject matter (including non-contractual disputes or claims).

2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

3 This Certificate will be displayed on the BBA website, and the Certificate Holder is entitled to use the Certificate and Certificate logo, provided that the product and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

5 In issuing this Certificate the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product or any other product
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product
- actual installations of the product, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to UKCA marking and CE marking.

6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product which is contained or referred to in this Certificate is the minimum required to be met when the product is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.